

1 E4.01

1 E4.04

1 E4.02

1 E4.03

- LEGEND:**
- ⊕ DUPLEX RECEPTACLE
  - ⊕ QUAD RECEPTACLE
  - ⊕ JUNCTION BOX
  - GFI ⊕ GFCI TYPE RECEPTACLE
  - WP ⊕ SPECIAL USE RECEPTACLE - VOLTAGE, PHASE AND AMPERAGE BASED ON LOAD SERVED. COORDINATE NEMA CONFIGURATION WITH EQUIPMENT REQUIREMENTS.
  - ⊕ SWITCH
  - ⊕ DISCONNECT SWITCH
  - ⊕ ELECTRICAL DROP FROM OVERHEAD
  - ⊕ ELECTRICAL SUB-UP
  - ⊕ TELEPOWER POLE - LETTER INDICATES MODEL #


- GENERAL NOTES:**
1. DIMENSIONS FOR CONDUIT SUB-UPS IN SALES AREA ARE TO BE HELD WITHIN 1".
  2. ANY EXPOSED CONDUIT IN PREP AREAS SHALL BE SECURELY FASTENED IN PLACE AS PER CODE.
  3. ALL DUPLEX RECEPTACLES SHALL BE MOUNTED 18" A.F.F. UNLESS NOTED OTHERWISE.
  4. THE CONDENSATION DRAIN HEAT TAPE RECEPTACLES FOR THE ICE CREAM STORAGE AND MEAT/DEL/BAKERY FREEZERS SHALL BE INSTALLED TO CEILING NEAR THE DRAIN END OF EVAPORATOR AFTER THE EVAPORATOR HAS BEEN INSTALLED.
  5. THE MECHANICAL CONTRACTOR SHALL SUPPLY THE AIR CURTAINS, AIR CURTAIN MOUNTING BRACKETS AND MICRO-SWITCHES.
  6. THE ELECTRICAL CONTRACTOR SHALL INSTALL AND WIRE THE MICRO-SWITCH FOR AIR CURTAIN CONTROL.
  7. ALL NEW AND EXISTING RECEPTACLES IN PREP AREAS SHALL HAVE "N-USE" WATERPROOF RECEPTACLE COVERS.
  8. ALL NEW DISCONNECTS SHALL BE "G.E." GENERAL DUTY.
  9. ALL NEW HOME RUNS SHALL GO TO EXISTING PANELS, UNLESS INDICATED OTHERWISE.
  10. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR RUNNING ALL WIRING TO PANELS. THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL CONDUIT AND CABLES AS SHOWN ON DRAWINGS.
  11. ALL WIRING SHALL BE DONE IN STRICT ACCORDANCE WITH N.E.C. STANDARDS AND WITH FOOD LION STANDARDS. ONLY NEAT, FIRST QUALITY WORK WILL BE ACCEPTED.
  12. ELECTRICAL CONTRACTOR IS NOT PERMITTED TO USE MC, BX CABLE, SO CORD OR ANY FLEXIBLE CONDUIT/WIRING METHODS AS A PERMANENT METHOD OF POWERING EQUIPMENT, UNLESS OTHERWISE NOTED WITHIN THE DRAWINGS. SHORT RUNS OF FLEXIBLE CONDUIT (#1) ARE PERMITTED FROM JUNCTION BOX TO LIGHT FIXTURES OR AS STATED IN THE FOOD LION SPECIFICATIONS 16422 - PART 3. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR SUPPLYING ALL ELECTRICAL EQUIPMENT NEEDED FOR ALL NEW AND RELOCATED MECHANICAL EQUIPMENT. COORDINATE ELECTRICAL HOOK-UPS WITH MECHANICAL CONTRACTOR.
  13. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING ALL OPEN JUNCTION BOXES, PANELS, BREAKER SPACES, RECEPTACLES AND WIRING RACKWAYS HAVE PROPER COVER PLATES INSTALLED THROUGHOUT THE STORE. REPLACE ALL MISSING, BROKEN OR OTHERWISE DEFICIENT COVER PLATES. NON WEATHERPROOF DEVICE COVERS TO BE STAINLESS STEEL WEATHERPROOF DEVICE COVERS ARE TO BE INSTALLED IN PREP AREAS AND ON THE EXTERIOR. ALL WEATHERPROOF COVERS TO BE ALUMINUM.
  14. ALL NEW DISCONNECTS SHALL BE GENERAL ELECTRIC, GENERAL DUTY AT A MINIMUM, 3R RATED AS REQUIRED, AND NON WEATHERPROOF UNLESS SPECIFIED OTHERWISE IN THE DRAWINGS.
  15. ALL BRANCH CIRCUIT PANEL BOARDS SHALL BE VACUUMED, ALL ELECTRICAL ENCLOSURE COVERS SHALL BE INSTALLED AND ADEQUATELY SECURED TO OBTAIN PROJECT CLOSE OUT.
  16. ALL BRANCH CIRCUIT PANEL BOARDS, SAFETY ELECTRICAL DISTRIBUTION EQUIPMENT, MAIN BREAKERS, AND MAIN SERVICE DISCONNECTS SHALL BE LABELED WITH PHENOLIC TAPS, BLACK ON WHITE, 1.5" TALL DISTRIBUTION SECTIONS SHALL BE LABELED ACCORDING TO IEC FLASH LABELS.
  17. ALL BRANCH CIRCUIT PANEL BOARDS, SAFETY ELECTRICAL DISTRIBUTION EQUIPMENT, MAIN BREAKERS, AND MAIN SERVICE DISCONNECTS SHALL BE LABELED WITH PHENOLIC TAPS, BLACK ON WHITE, 1.5" TALL DISTRIBUTION SECTIONS SHALL BE LABELED ACCORDING TO IEC FLASH LABELS.
  18. A FOOD LION ELECTRICAL CONTRACTOR (MID-CAROLINA) WILL INSTALL THE FRONT-END ELECTRICAL THIS INCLUDES AND IS LIMITED TO ALL CHECK STANDS, CIGARETTE KIOSK, AND CUSTOMER SERVICE COUNTERS. THIS INCLUDES SETTING AND HANDLING EQUIPMENT, CLEAN AND DIRTY POWER, ASSOCIATED CATS AND BELDON CABLES. THIS SCOPE OF WORK SHALL BE INCLUDED IN THE PERMIT AND COORDINATED AS SUCH. THE BID ELECTRICAL CONTRACTOR SHALL BE ON SITE THE NIGHT OF THE FRONT END CHANGE OUTFIT, PROVIDE & INSTALL TELEPOLES.
  19. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR THE POWER/COMMUNICATIONS FOR THE PC TRAINING ROOM, DSD COUNTER AND ALL CATS CABLES NOT RELATED TO THE REGISTERS, CIGARETTE KIOSK AND CUSTOMER SERVICE COUNTER. ALL RECEPTACLES ARE TO BE MOUNTED ABOVE THE COUNTER TOPS WITH WIRING SECURED AT OUTLETS.
  20. FREEZER DOOR SWITCHES SHALL BE PROVIDED BY REFRIGERATION CONTRACTOR. ELECTRICAL CONTRACTOR SHALL MOUNT SENSOR, PROVIDE CONDUIT AND PROVIDE 3 PAIR, 22 GAUGE SHIELDED CABLE FROM FREEZER TO RACK ROOM. REFRIGERATION CONTRACTOR WILL PERFORM FINAL TERMINATION. GO TO PAINT ALL EXPOSED CONDUIT IN PRODUCE PREP AND MEAT PREP "WHITE".
  21. ALL ELECTRIC POWER, DISCONNECTS, ETC. LOCATED IN WET AREAS (MEAT PREP, PRODUCE PREP, ETC.) TO BE WATERPROOF BOXES.
  22. REMOVAL/RELOCATION OF ESCOLAB FLY TRAPS TO BE COORDINATED WITH VENDOR VIA FOOD LION CONSTRUCTION MANAGER. EC TO PROVIDE POWER.

**TELEPOWER POLE INSTALLATION NOTES**

1. CONDUITS FROM "OR" & "OW" SHALL BE AS FOLLOWS:
    - (1) 2" CONDUITS FROM PANEL "OR" - TWO CHECKOUTS MAXIMUM PER CONDUIT. PROVIDE ADDITIONAL CONDUITS AS REQUIRED.
    - (2) 1" CONDUIT FROM PANEL "OW" DEDICATED TO DIRTY POWER FOR BELT MOTOR, SENSOR-MATIC DEACTIVATION PADS & GENERAL RECEPTACLES
  2. CASH REGISTER CIRCUITS SHALL BE PROVIDED WITH DEDICATED NEUTRAL AND GREEN DEDICATED CIRCUIT.
  3. BX CABLES SHALL BE INSTALLED WITH INSULATED THROATS AND APPROVED CONNECTORS.
  4. TELEPOLES SHALL BE INSTALLED SECURE AND PLUMB; TOP CONNECTION OF TELEPOLE TO BAR JOIST SHALL BE CONNECTED WITH A LEGRAND/WIREMOLD SLIDING SUPPORT (#633204 FOR 2-CHANNEL POLES, #633203 FOR 3-CHANNEL POLES) THAT WILL ALLOW DEFLECTION OF THE BAR JOIST WITHOUT BOWING THE TELEPOLE.
  5. INSTALL ADAPTER TO REGISTER STAND TOP. A HOLE IS PROVIDED IN REGISTER STAND TOP AT THE DESIRED LOCATION. THE ADAPTER MUST BE INSTALLED SO THAT POLES GROMMET OPENING AND POWER CORD ARE FACING TOWARDS THE REAR OF THE STORE.
  6. TELEPOLE CUT IN THE FIELD TO BE CUT AT THE TOP ONLY AND FILED SMOOTH.
  7. NEW TELEPOLES TO BE FURNISHED & INSTALLED AS FOLLOWS:
    - \*\* TELEPOLES AT CHECKSTANDS - FOOD LION VENDOR
    - \*\* TELEPOLES IN SALES AREA (PRODUCE, WINE, CENTER STORE, ETC.) - ELECTRICAL CONTRACTOR
  8. COORDINATE EXACT TELEPOLE LOCATION WITH FOOD LION CONSTRUCTION MANAGER DURING TIME OF STORE SET.
  9. REAR SECTION OF TELEPOLE IS FOR POWER, FRONT SECTION IS FOR COMMUNICATIONS.
  10. IF EXTENSION IS NEEDED, USE #AMP3022 (2 CHANNEL POLES) OR #AMP3063 (3 CHANNEL POLES).
  11. 3-CHANNEL TELEPOLES AT CHECK STANDS (TYPE DR AND DL) SHALL INCLUDE LIGHT BRACKET #633920.
  12. EXISTING TELEPOLES TO BE PAINTED SILVER BY GC.
- MODEL #S**
- [A] FLAMP0685
    - SPL AMTP-412 12FT 2-CHANNEL POLE WITH SLIDING SUPPORT #633204 AND (1) L5-20R 3/3 & 4/4 SLANT BINS
  - [B] FLAMP0686
    - SPL AMTP-412 12FT 2-CHANNEL POLE WITH SLIDING SUPPORT #633204 AND (1) L6-20R 3/6 BIN, 3x8 BIN, 5x5 BERRY QUAD
  - [C] FLAMP0907
    - SPL AMTC-412 12FT 2-CHANNEL POLE (BLANK) WITH SLIDING SUPPORT #633204, GROMMET AND STANDARD GRAY BOOT
    - CUSTOMER SERVICE COUNTER, WING BAR (OR WHEN ONE-OFF RECEPTACLE OR NO RECEPTACLE REQUIRED)
  - [D] FLAMP0757 (LEFT HAND)
    - SPL ALUMINUM 3-CHANNEL POLE WITH SLIDING SUPPORT #633204-3 AND LANE LIGHT MOUNTING BRACKET #633920 (2-1/4"x3-5/16")
    - CHECKSTANDS, CUSTOMER SERVICE CHECKSTAND #1
  - [E] FLAMP0757 (RIGHT HAND)
    - SPL ALUMINUM 3-CHANNEL POLE WITH SLIDING SUPPORT #633204-3 AND LANE LIGHT MOUNTING BRACKET #633920 (2-1/4"x3-5/16")
    - CHECKSTANDS, CUSTOMER SERVICE CHECKSTAND #1
  - [F] FLAMP0264
    - SPL AMTP-412 12FT 2-CHANNEL POLE WITH SLIDING SUPPORT #633204 AND (1) NEMA 3-3R & STANDARD GRAY BOOT
    - SELF-CONTAINED WINE CASE

**POWER PLAN KEY NOTES**

1. SURFACE MOUNTED HAND DRYERS TO BE POWERED FROM DEDICATED CIRCUIT.
2. COORDINATE GFI RECEPTACLE HEIGHT WITH OVERHEAD TOP HEIGHT (46" AFF). COORDINATE EXACT HEIGHT WITH FOOD LION CONSTRUCTION MANAGER.
3. RELOCATED EQUIPMENT CIRCUIT TO NEW LOCATION. EXTEND CIRCUITRY AS REQUIRED.
4. RECONNECT EXISTING CIRCUIT TO NEW EQUIPMENT (REPLACING EXISTING EQUIPMENT). ELECTRICAL CONTRACTOR TO VERIFY EXISTING CIRCUIT IS NOT OVERLOADED.
5. THE ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT ALL ELECTRICAL CONNECTIONS ARE CAPPED-OFF WITHIN 5'-0" OF THE FIRM LOCATION OF THE RELOCATED EQUIPMENT. ELECTRICAL CONTRACTOR SHALL REMOVE ALL WIRING AND CAP-OFF GONDBURTS.
6. THE ELECTRICAL CONTRACTOR SHALL PROVIDE GFI, WP, WP RECEPTACLE AT PRIMO RETURN LOCATION COORDINATE EXACT LOCATION OF RECEPTACLE WITH FOOD LION CONSTRUCTION MANAGER.
7. GONDBURTS ON THIS WALL TO BE RECESSED BEHIND GNB.
8. DUPLEX RECEPTACLE MOUNTED 18" AFF. (DIMENSIONS - BLUE).
9. EXTEND EXISTING COMMUNICATIONS CONNECTIONS TO RELOCATED REDDOX LOCATION.
10. VERIFY EXISTING CONNECTIONS MEET FOOD LION REQUIREMENTS.
11. TELEPOWER POLE FOR SELF-CONTAINED REFRIGERATED CASE. SEE LEGEND THIS SHEET.
12. RELOCATE EXISTING TELEPOWER POLE AND CIRCUITING FOR RELOCATED SELF-CONTAINED REFRIGERATED CASES.
13. DUPLEX GFI RECEPTACLE WITH WATERPROOF COVER FOR SAMPLING STATION, MOUNTED IN KICK PLATE OF MEAT PRIMO CASE.
14. JUNCTION BOX ABOVE CEILING FOR LOUNGE TV.
15. CIRCUIT FOR PRODUCE MONITOR. INSTALL IN TELEPOWER POLE FOR CASE.
16. RELOCATE EXISTING DISCONNECT AND CORD CONNECTION. SEAL CONDUIT PENETRATION THROUGH INSULATED PANEL.

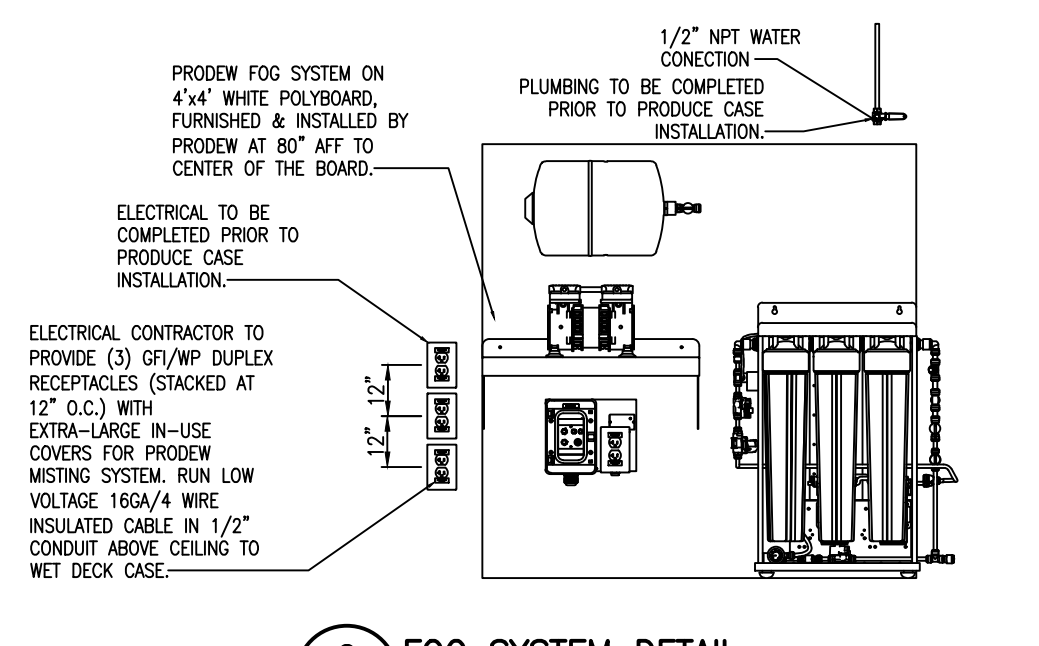

2 FOG SYSTEM DETAIL E1.02 N.T.S.

1 POWER PLAN E1.02 SCALE: 3/32" = 1'-0"

PROFESSIONAL'S SEAL:



08/29/2022

CORPORATE SEAL:

REVISIONS NO. DATE REMARKS

**FOOD LION REMODEL STORE #1657**  
 4330 E. TENTH STREET GREENVILLE, NC

PROJECT NO: 1657/FLMK22

DATE: 08/29/2022

29 OF 40

E1.02

POWER PLAN

CHECKED: DOD DRAWN: DBD