


**1 LEGACY CAT 5E RISER DIAGRAM**  
E2.01 NOT TO SCALE

- CAT 5 RISER NOTES:**
- ④ CIRCLE INDICATES THE NUMBER OF CABLES, SUPPLIED AND INSTALLED BY THE ELECTRICAL CONTRACTOR UNLESS OTHERWISE NOTED (SEE NOTE #4). CABLE SHALL BE CAT 5 UNSHIELDED ETHERNET. COIL AND SECURE 15'-0" OF SLACK FOR ALL CABLE ENDS.
  - ALL CABLE ENDS SHALL BE LABELED PER RISER DIAGRAM.
  - ALL CABLE ENDS SHALL BE NUMBERED. DO NOT REUSE NUMBERS.
  - FOOD LION COMMUNICATION VENDOR TO PROVIDE POWER AND PULL 2 CAT-5 PVC-COATED UNSHIELDED ETHERNET CABLES PER REGISTER (REGISTER CPU & CATALINA PRINTER); SEE A1.01. COIL 15'-0" OF EXTRA CAT-5 CABLE AT EACH END FOR CONNECTION BY OTHERS.
  - FOOD LION COMMUNICATION VENDOR TO PROVIDE POWER AND CAT-5 CABLES TO ALL CUSTOMER SERVICE COUNTER EQUIPMENT.
  - ELECTRICAL CONTRACTOR TO PROVIDE POWER AND CAT-5 CABLES FOR ALL OTHER FRONT-END SERVICES.
  - ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE FOOD LION CONSTRUCTION MANAGER AND TELEPHONE RISER DIAGRAM PRIOR TO BEGINNING WORK TO PREVENT PULLING DUPLICATE OR UNNECESSARY RUNS.
  - ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE LOCAL LOTTERY REPRESENTATIVE FOR CORRECT LOCATION OF CAT-5 PULL (TELEPHONE BACKBOARD OR DATA CLOSET/CASH OFFICE).

**IMPORTANT EC NOTE:**

BEFORE ANY CAT-5 CABLING WORK IS COMPLETED, THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE FOOD LION CONSTRUCTION MANAGER AND NEXGEN.

BIDDING ELECTRICAL CONTRACTOR SHALL PROVIDE SEPARATE LINE ITEM BID FOR CAT-5 WORK.

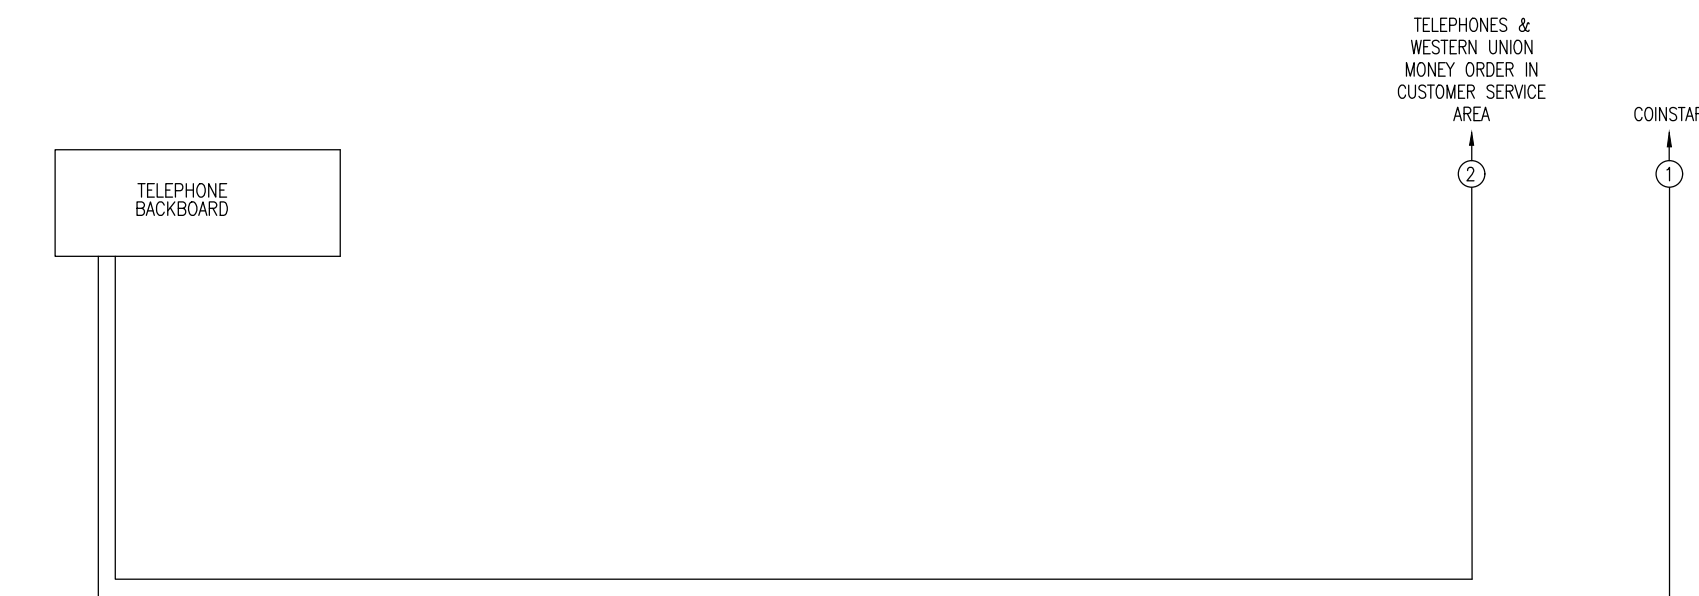

**2 LEGACY TELEPHONE RISER DIAGRAM**  
E2.01 NOT TO SCALE

- TELEPHONE RISER NOTES:**
- THE CONDUITS TO THE TELEPHONE BACKBOARD MUST BE INSTALLED AS PER THIS DIAGRAM. ALL DATA PULLS ARE HOMERUNS AND ARE NOT TO BE LOOPED OR TIED TOGETHER IN A JUNCTION BOX... (FOOD LION COMMUNICATIONS VENDOR TO VERIFY RISER)
  - ④ CIRCLE INDICATES THE NUMBER OF PHONE CABLES, SUPPLIED AND INSTALLED BY THE ELECTRICAL CONTRACTOR. CABLE SHALL BE CAT 5 UNSHIELDED ETHERNET. COIL AND SECURE 15'-0" OF SLACK FOR ALL CABLE ENDS.
  - ALL CABLE ENDS SHALL BE LABELED PER RISER DIAGRAM.
  - ALL CABLE ENDS SHALL BE NUMBERED IF MORE THAN ONE PER CONDUIT.
  - ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE FOOD LION CONSTRUCTION MANAGER AND CAT-5 RISER DIAGRAM PRIOR TO BEGINNING WORK TO PREVENT PULLING DUPLICATE OR UNNECESSARY RUNS.
  - FOR PENNSYLVANIA STORES ONLY, THERE SHALL BE (1) CAT-5 FROM THE TERMINAL IN THE CUSTOMER SERVICE COUNTER TO THE DATA CLOSET.
  - ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE LOCAL LOTTERY REPRESENTATIVE FOR CORRECT LOCATION OF CAT-5 PULL (TELEPHONE BACKBOARD OR DATA CLOSET/CASH OFFICE).

PROFESSIONAL'S SEAL:



08/29/2022  
CORPORATE SEAL:

REVISIONS  
NO DATE REMARKS

**FOOD LION REMODEL STORE #1657**  
4330 E. TENTH STREET  
GREENVILLE, NC

PROJECT NO: 1657FLMK22  
DATE: 08/29/2022

31 OF 40  
**E2.01**

ELECTRICAL ELEVATIONS & DETAILS  
CHECKED: DOD DRAWN: DBD